

PERFORMANCE OF SOLAR AIR-CONDITIONING SYSTEM USING HEAT PIPE  
EVACUATED TUBE COLLECTOR

MAHENDRAN A/L MOORTHY

Report submitted in partial fulfilment of the  
requirements for the award of the degree of  
Bachelor of Mechanical Engineering

Faculty of Mechanical Engineering  
UNIVERSITI MALAYSIA PAHANG

DECEMBER 2010

### **SUPERVISOR'S DECLARATION**

I hereby declare that I have checked this project and in my opinion, this project is adequate in terms of scope and quality for the award of the degree of Bachelor of Mechanical Engineering.

Signature

Name of Supervisor: LEE GIOK CHUI

Position: LECTURER OF FACULTY OF MECHANICAL ENGINEERING

Date: 6 DECEMBER 2010

### **STUDENT'S DECLARATION**

I hereby declare that the work in this project is my own except for quotations and summaries which have been duly acknowledged. The project has not been accepted for any degree and is not concurrently submitted for award of other degree.

Signature

Name: MAHENDRAN A/L MOORTHY

ID Number: MA07072

Date: 6 DECEMBER 2010

## **ACKNOWLEDGEMENT**

All the way through the development of this project I have learnt new skills and knowledge about the renewable energy especially the solar energy. I wish to express my sincere appreciation and gratitude to my supervisor, Mr. Lee Giok Chui for his continuous guidance, concern, encouragement and advice which gave me much inspiration in accomplishing my final year project.

Special thanks to Solar District Cooling Sdn. Bhd and University Malaysia Pahang for supporting and providing equipment and information sources that assisted my studies and projects.

My sincere gratitude to the lecturers of Faculty of Mechanical Engineering who have put in effort to the lectures and always nurture and guide us with precious advices.

Last but not least, my dearly loved family members and friends who always are helping me in my life.

## ABSTRACT

This is a study on the performance of solar air-conditioning system using heat pipe evacuated tube collector. The objective of this project is to analysis the performance solar air-conditioning system by determining the solar collector efficiency, coefficient of performance (COP) of the absorption chiller, and overall system efficiency and also the electrical energy consumption and operation cost for the system and compare it with the conventional air-conditioning system from the previous case study. The existing solar air-conditioning system is not competitive with electricity driven air-conditioning system because of their high investment and installation cost. Its overall thermal energy conversion efficiency is relatively low, and from an economical point of view, solar cooling and refrigeration are not competitive with the conventional systems. The experiment is conducted at Solar District Cooling Sdn. Bhd and data collected from building automation system for 30 days from 1<sup>st</sup> – 30<sup>th</sup> June 2010. The data analysed using the theoretical analysis and plotted in graph to discuss about it. The solar collector efficiency varies from 50 to 80% during day time and stored energy can be used during night time. The COP varies from 2.961-2.966 and the overall system efficiency is from 30 to 50%. The investment cost is higher and electrical consumption is relatively lower than conventional air-conditioning system. The economical view is profitable after 18 years and 7 months of installation and environmental view is green energy without pollution. Although all the above findings refer to a particular application in Malaysia, the similar results can be obtained in the country with high solar availability. Finally by considering the problem of pollution of the planet due to the burning of fossil fuels the adoption of solar energy to power absorption chillers, even with marginal economic benefits, should not be underestimated.

## ABSTRAK

Ini adalah kajian prestasi sistem pendingin udara suria dengan menggunakan dievakuasi kolektor tenaga suria. Tujuan kajian ini adalah untuk menganalisis sistem pendingin udara solar dengan menentukan kecekapan kolektor, pekali prestasi (COP) dari chiller penyerapan, dan kecekapan sistem secara keseluruhan dan juga pengambilan tenaga elektrik dan kos operasi untuk sistem dan bandingkan dengan sistem pendingin hawa konvensional daripada kajian kes dahulu. Sistem pendingin udara suria tidak kompetitif dengan sistem pendingin hawa konvensional kerana pelaburan yang tinggi dan kos pemasangan. Sistem pendingin udara suria juga mempunyai kecekapan tenaga keseluruhan penukaran terma relatif rendah, dan dari pandangan ekonomi, pendingin udara suria dan pendinginan yang tidak kompetitif dengan sistem konvensional. Eksperimen dijalankan di Solar District Cooling Sdn. Bhd dan data yang dikumpul daripada sistem automasi bangunan selama 30 hari dari 01-30 Jun 2010. Data dianalisis secara teori dan diplot dalam graf untuk membincangkan. Kecekapan kolektor suria bervariasi dari 50 hingga 80% sepanjang siang hari dan tenaga yang disimpan boleh digunakan pada waktu malam. pekali prestasi (COP) dari chiller penyerapan adalah bervariasi dari 2,961-2,966 dan kecekapan sistem secara keseluruhan dari 30 hingga 50%. Kos pelaburan lebih tinggi dan penggunaan kuasa elektrik yang relative lebih rendah berbanding dengan system pendingin hawa konvensional. Pandangan ekonomi menguntungkan selepas 18.6 tahun pemasangan dan dari pandangan persekitaran adalah tenaga hijau tanpa pencemaran. Walaupun semua penemuan di atas merujuk pada aplikasi di Malaysia, keputusan yang sama boleh diperolehi oleh Negara sama iklim. Akhirnya dengan mempertimbangkan masalah pencemaran pelaksanaan tenaga suria untuk pendingin penyerapan tenaga kerja, boleh bermanfaat.

## TABLE OF CONTENTS

	<b>Page</b>
<b>TITLE PAGE</b>	i
<b>SUPERVISOR’S DECLARATION</b>	ii
<b>STUDENT’S DECLARATION</b>	iii
<b>DEDICATION</b>	iv
<b>ACKNOWLEDGEMENT</b>	v
<b>ABSTACT</b>	vi
<b>ABSTRAK</b>	vii
<b>TABLE OF CONTENTS</b>	viii
<b>LIST OF TABLES</b>	xi
<b>LIST OF FIGURES</b>	xii
<b>LIST OF SYMBOLS</b>	xiv
<b>LIST OF ABBREVIATIONS</b>	xv
<b>LIST OF APPENDICES</b>	xvi

### **CHAPTER 1      INTRODUCTION**

1.1	Background	1
1.2	Problem Statement	2
1.3	Objectives	3
1.4	Scope of the Project	3
1.5	Limitation	4

### **CHAPTER 2      LITERATURE REVIEW**

2.1	Solar Air-conditioning system	5
	2.1.1    System Description	5
2.2	Solar Collector Evacuated Tube	9

2.2.1	Direct-flow evacuated tube collector	10
2.2.2	Heat Pipe evacuated tube collector	10
2.3	Absorption Chiller	11
2.3.1	Absorption Cycle	12
2.4	The Sun and Solar Position	14
2.4.1	The Sun-Earth relationship	14
2.4.2	Terminology	19

### **CHAPTER 3      METHODOLOGY**

3.1	Introduction	25
3.2	Flow chart	26
3.3	Experimental Process Description	27
3.3.1	Experimental design, setup and apparatus	27
3.3.2	Theoretical formulation and calculation	30
3.3.3	Graphical Analysis	31

### **CHAPTER 4      RESULTS AND DISCUSSION**

4.1	Analysis of Solar air-conditioning system	32
4.1.1	Data collection	32
4.1.2	Performance analysis of heat pipe evacuated tube	33
4.1.3	The coefficient of performance of absorption chiller	43
4.1.4	The overall efficiency of the system	45
4.2	Energy Consumption Analysis	46

### **CHAPTER5      CONCLUSION**

5.1	Conclusion	50
5.2	Recommendation	51



<b>REFERENCES</b>	<b>52</b>
-------------------	-----------

## **APPENDICES**

A	Technical data and efficiency curve	54
B	Tabulated data	56
C	Graphical data	80

**LIST OF TABLES**

<b>Table No.</b>	<b>Title</b>	<b>Page</b>
4.1	Solar Energy Parameters from NASA Surface Meteorology and Solar Energy	33
4.2	Electrical energy consumption of conventional air-condition	46
4.3	Electrical energy consumption of solar air-condition	47
4.4	Cost of electrical consumption for 20 years	48

## LIST OF FIGURES

Figure No.	Title	Page
2.1	The schematic diagram of the system	6
2.2	The Building Automation System	8
2.3	Direct-flow evacuated-tube collector	9
2.4	Heat pipe evacuated tube collector	10
2.5	Absorption cycle	14
2.6	The sun earth relationship	15
2.7	Cross-sectional details of the sun	16
2.8	Orbit of the earth around the sun	17
2.9	Distribution of solar energy	18
2.10	Representation of various terminologies	20
2.11	Zenith and solar altitude angles	21
2.12	Slope $\beta$ , Surface $\gamma$ and solar azimuth angle $\gamma_s$	22
2.13	Declination and hour angle	23
2.14	Path traced by the sun relative to earth	23
3.1	Fan coil unit and 6000ft <sup>2</sup> or 557m <sup>2</sup> area served by the solar air conditioning system	27
3.2	84 heat pipe evacuated collector panel has 235.2m <sup>2</sup> absorber area	28
3.3	Absorption chiller, hot and chill water storage tank	28
3.4	The cooling tower of the absorption chiller	29

3.5	Pumps and piping of the system	29
4.1	Average collector temperature against time	34
4.2	Average collector temperature 1 <sup>st</sup> June 2010	35
4.3	Average collector temperature 10 <sup>th</sup> June 2010	36
4.4	Average collector temperature 20 <sup>th</sup> June 2010	37
4.5	Average collector temperature 30 <sup>th</sup> June 2010	38
4.6	The Collector Efficiency against Time	40
4.7	The Collector Efficiency against Time 1 <sup>st</sup> June 2010	40
4.8	The Collector Efficiency against Time 10 <sup>th</sup> June 2010	41
4.9	The Collector Efficiency against Time 20 <sup>th</sup> June 2010	42
4.10	The Collector Efficiency against Time 30 <sup>th</sup> June 2010	43
4.11	The COP of the absorption chiller against Time	44
4.12	The overall efficiency of the solar system against time	45
4.13	Breakeven point analysis of the payback period	49

**LIST OF SYMBOLS**

$\eta_c$	solar collector efficiency
$\eta$	overall system efficiency
$\rho$	density of water (kg/m <sup>3</sup> )
$t$	time (second)
$\beta$	Slope
$\gamma$	Surface azimuth angle
$\gamma_s$	solar azimuth angle

## LIST OF ABBREVIATIONS

SDC	Solar District Cooling
BAS	Building Automation System
NASA	National Aeronautics and Space Administration
ETC	evacuated tube collector
COP	coefficient of performance
COP <sub>max</sub>	maximum coefficient of performance
T <sub>in</sub>	inlet collector water temperature (°C)
T <sub>out</sub>	outlet collector water temperature (°C)
T <sub>ave</sub>	average collector temperature (°C)
T <sub>amb</sub>	ambient temperature (°C)
I	insolation (W/m <sup>2</sup> )
G	global solar irradiance (W/m <sup>2</sup> )
G <sub>b</sub>	direct solar irradiance (W/m <sup>2</sup> )
G <sub>d</sub>	diffuse solar irradiance (W/m <sup>2</sup> )
V	volume of the heat storage water tank (m <sup>3</sup> )
C <sub>p</sub>	specific heat of water (J/kg °C)

**LIST OF APPENDICES**

<b>Appendix No.</b>	<b>Title</b>	<b>Page</b>
A	Technical Data and efficiency curve	54
B	Tabulated Data	56
C	Graphical Data	80

## **CHAPTER 1**

### **INTRODUCTION**

#### **1.1 BACKGROUND**

Air-condition is the most energy consuming service in buildings in many equatorial countries such as Malaysia. Malaysia has an equatorial climate, It has good sunshine, warm and wet weather throughout the year. The demand of cooling increases by every year and the solar powered air-conditioning is an alternative way to meet the demand in buildings in an energy efficient way. The solar thermal technologies are used to collect the energy of the sun to provide thermal energy for solar water heating, solar pool heating, solar space heating and cooling, and industrial process pre-heating.

The Solar District Cooling Sdn. Bhd (SDC), an evolving company incorporated in Malaysia, is dedicated to provide leading technology solutions for renewable energy. The company building consists of four storeys. The ground floor the common area (main lobby, lift lobby and VIP room) is served by solar air-conditioning system. The solar air-conditioning system is fully automatic and it is observed by Building Automation System (BAS). BAS is located at SDC control room and it is used to record data and observe the maintenance of the system.



## 1.2 PROBLEM STATEMENT

Nowadays, some modern buildings are running on solar powered air-conditioning system, and the main reason is to conserve the electrical energy. The current problem faced by solar air-conditioning system are;

- I. The overall thermal energy conversion efficiency is relatively low, and from an economical point of view, solar cooling and refrigeration are not competitive with the conventional systems.
- II. The existing solar air-conditioning system is not competitive with electricity driven or gas-fired air-conditioning system because of their high investment and installation cost. The investment cost only can be reduced if the performance is improved which will lower the investment cost eventually. The improvements can be made such as the reduction of the solar collector area with higher efficiency energy collector.
- III. The solar air-conditioning system is highly dependent upon solar parameters such as solar insolation incident on a horizontal surface, solar radiation incident on an equator-pointed tilted surface, and daylight hours. Besides that, air temperature, wind speed, and cloud are factors that affects on solar air-conditioning system.

### 1.3 OBJECTIVE

The objectives of this project was to;

- I. Performance analysis of the solar air-conditioning system at SDC
  - a. Obtain the efficiency of heat pipe evacuated collector.
  - b. Determine the coefficient of performance (COP) of absorption chiller.
  - c. Determine the overall performance of a solar air conditioning system at SDC.
- II. Calculate the electrical energy consumption and operation cost for the system and compare it with the conventional air-conditioning system from the previous case study of SDC.

### 1.4 SCOPES OF THE PROJECT

The scopes were:

- I. Equipments :
  - a) Absorption Chiller  
 Model: Sanyo LCC-E01  
 Capacity: 30RT  
 Feature: Market leader with advanced technology in Li-Br absorption chiller, complying JIS B 8622-2002.
  - b) Sunda Evacuated Tube  
 Model: SDC SEIDO 1-16  
 Feature: SPF certified patented “Thermal-Compression Sealing Technology” prevents heat loss and protect from corrosion. Aluminum Nitride Coating ensures more than 92% high solar absorption.  
 Performance tested accordance to EN 12975.
  - c) The solar air-conditioning system data was collected from BAS.

- d) The solar parameters were obtained from NASA surface and solar energy science data at latitude  $2.983^{\circ}$  and longitude  $101.617^{\circ}$  the location of the SDC.

## II. Cooling Space

- a) Ikhasas Office Building – the ground floor common area (main lobby, lift lobby and VIP room) is served by solar air-conditioning system approximately  $6000 \text{ ft}^2$  or  $557 \text{ m}^2$ .

III. The data analysed using theoretical formula calculation to obtain the efficiency of heat pipe evacuated, coefficient of performance of absorption chiller, energy consumption, and operation cost.

IV. The experimental duration was for 30 days from 8.00 am until 6.00 pm from 1st-30th June 2010.

## 1.5 LIMITATION

- I. The parameters of the system cannot be changed because its running automatically and at fixed parameters.

## **CHAPTER 2**

### **LITERATURE REVIEW**

#### **2.1 SOLAR AIR-CONDITIONING SYSTEM**


In earlier studies performance of solar air conditioning system based on solar photovoltaic can be either a rankine engine or an electric motor. It is reported that, it has relatively low thermal conversion efficiency, which is about 10–15%, depending on the type of cells used (Kazmerski, 1997). In addition, considering an identical refrigeration output, the solar photovoltaic systems were four to five times more expensive than those powered by solar thermal utilization (Wang, 2002). Therefore, at present time, the most of the solar air conditioning system are using solar thermal utilization. In most of the solar cooling systems, single-stage or double-stage lithium bromide absorption chillers driven by hot water were commonly used (Li et al., 2001). The solar evacuated tubes or other high grade solar collectors were used to provide a hot water temperature of 88–90 °C as a heat source to drive the chiller. Experimental data on the performance of such systems were reported (Bong et al., 1987).

##### **2.1.1 System description**

The SDC solar air-conditioning system is SEIDO 1-16 heat pipe evacuated tube collector to collect the energy from the sun. The system uses water as the medium to collect the energy from the solar collector and the water piping system is well insulated. The SANYO LCC-E01 double effect absorption chiller with a pair of lithium bromide and water is used to absorb the energy and turn it into cooling effect. The system has hot and chill water storage tank about 8m<sup>3</sup> each and both are well insulated. The cooling tower used to bring down the temperature of the absorption chiller cooling water. The

system is fully automatic and it only starts to operate when the hot water storage tank temperature reached at 60 °C(SDC, 2008).

However, the system still requires some electricity to operate its pumps and fans. Some auxiliary conventional source is also required from time to time to maintain its operation during periods of insufficient sunshine. The schematic diagram of the system is shown in figure 2.1.

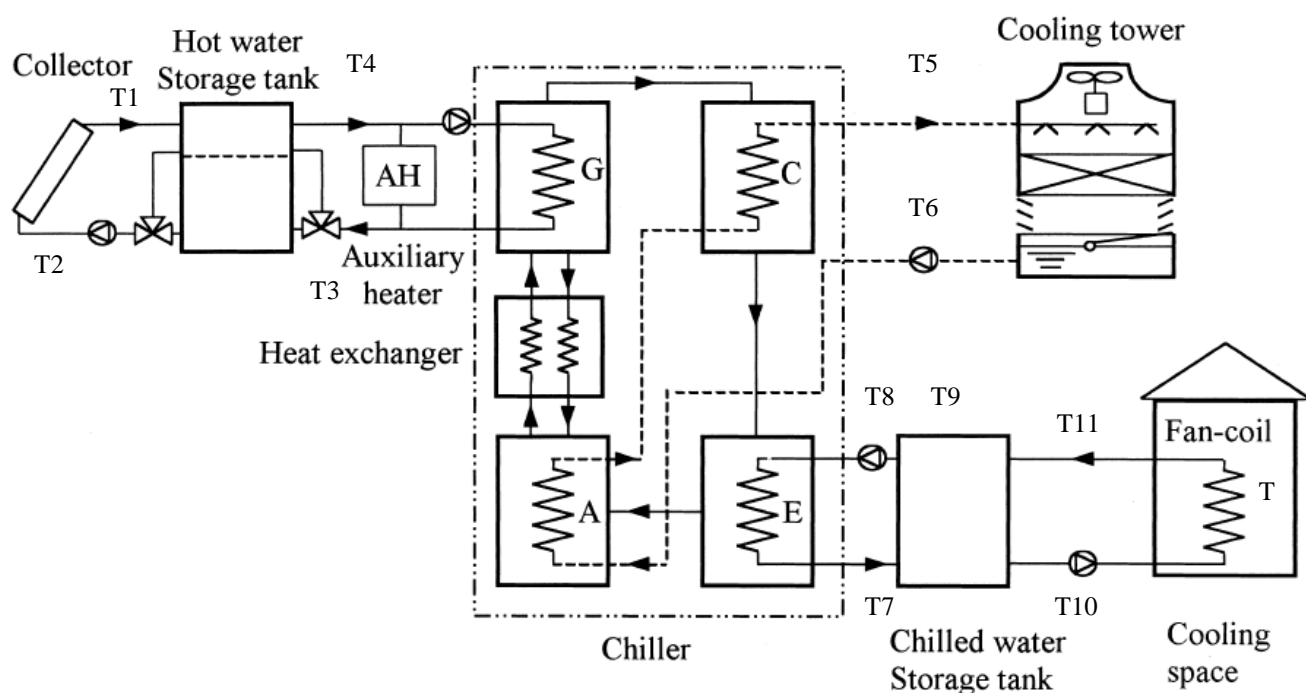

A – absorber; G – generator; C – condenser; E – evaporator

**Figure 2.1:** The schematic diagram of the solar air-conditioning system.

[ Source: Li et al., 2000]

The flow of solar air-conditioning is shown in figure 2.1. The hot water cycle, the water is pumped up to solar panels to collect the heat energy from sun by hot water tank pump with an inlet temperature of water,  $T_2$ . The outlet temperature of water,  $T_1$  from solar panels stored at hot water storage tank. The hot water from storage, pumped by hot water chiller pump into absorption chiller at temperature,  $T_4$ . The water returns to the storage tank at temperature,  $T_3$ . The cycle continues until reach the minimum temperature of  $60^{\circ}\text{C}$  and stop automatic below the minimum temperature.

The condenser water at temperature,  $T_5$  is pumped by condenser water pump to cooling tower enter into absorption chiller at temperature,  $T_6$ . The chill water cycle, water is pumped into absorption chiller at temperature,  $T_8$  from storage temperature,  $T_9$  and released out of chiller at temperature,  $T_7$  stored into chilled water storage after pass pressure valve,  $P_1$  and  $P_2$  with modulating valve,  $V_1$ . The chill water temperature,  $T_{10}$  is flow the five fans at temperature,  $T$  to cool the environment and enters to chilled water storage tank and completed the cycle.

The solar air conditioning system is observed by Building Automation System (BAS). BAS is used determine the need of maintenance and record the data of the system. The BAS observation of the system is shown in figure 2.2.

The BAS will take the reading of the system every 5 minutes and stored the data into specially allocated server and data storage devices. The system also can be monitored by using this BAS for maintenance and operational view.



## 2.2 SOLAR COLLECTOR EVACUATED TUBE

The evacuated solar collector are efficient compared to the flat plate collector. The evacuated solar collector are useful for commercial and industrial heating applications and it is an alternative to flat plate collector especially in areas where it is often cloudy. The each tube has the air removed from it (vaccumised) to eliminate heat loss through convection and radiation. The glass tube contains a flat aluminum or copper fin which is attached to a metal pipe. The fin is covered with a selective coating that transfers heat to the fluid that is circulating through the pipe. The fin colour is dark blue. There are two main types of evacuated tube collectors (Budihardjo et al., 2009):



**Figure 2.3:** Direct-flow evacuated-tube collector.

[ Source: Kratzenberg et al., 2006]